


Buderus G115/4 Boiler
 88,200 BTU/hr gross output
 (0.9 gph input @ 70% eff.)
 Taco 007 = 17 gph
 $\Delta T = 10^\circ\text{F}$

Probable end
 state of most
 boiler cycles

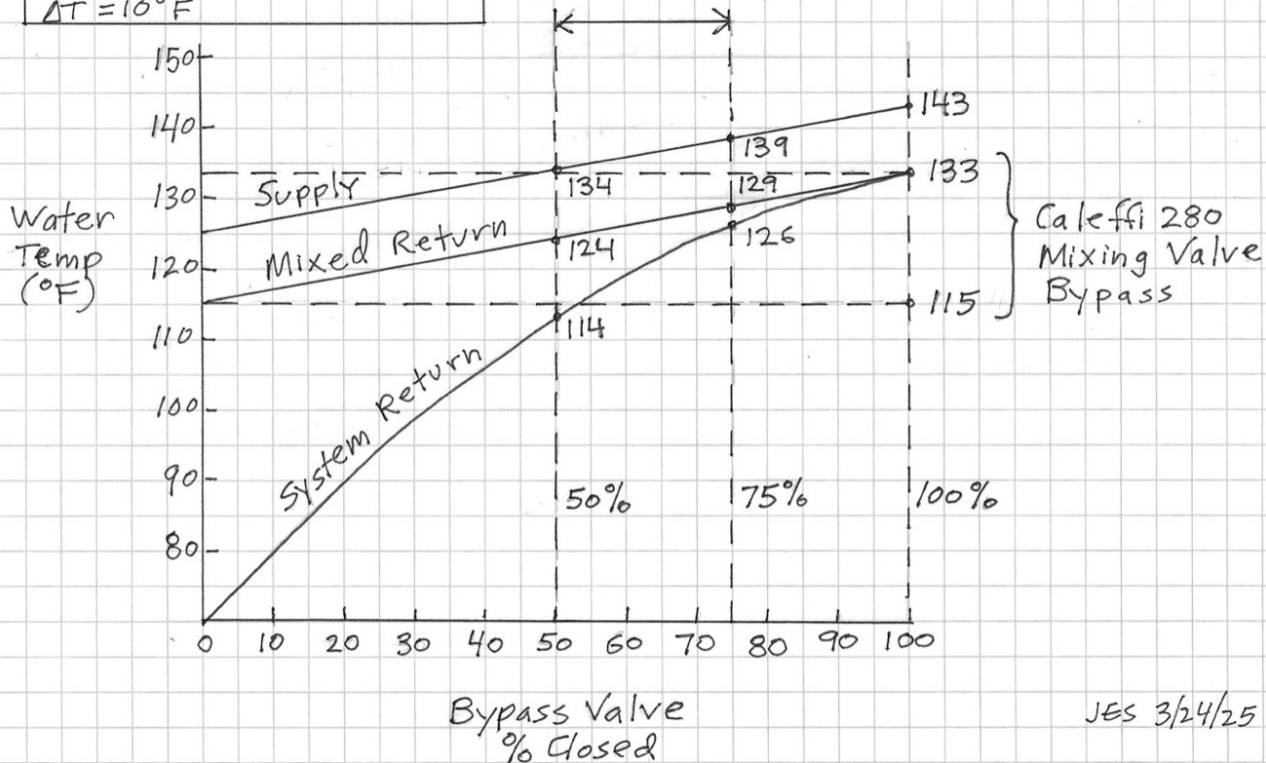

JES 3/24/25