

Palmer Empire, Building #16600, Steam Heating System: Standard Two-Pipe Upgrade to *Vapor Vacuum Return*

Pump used: GRUNDFOS UP-26-64F, 1/12TH HP, flanged, SKU 52722330

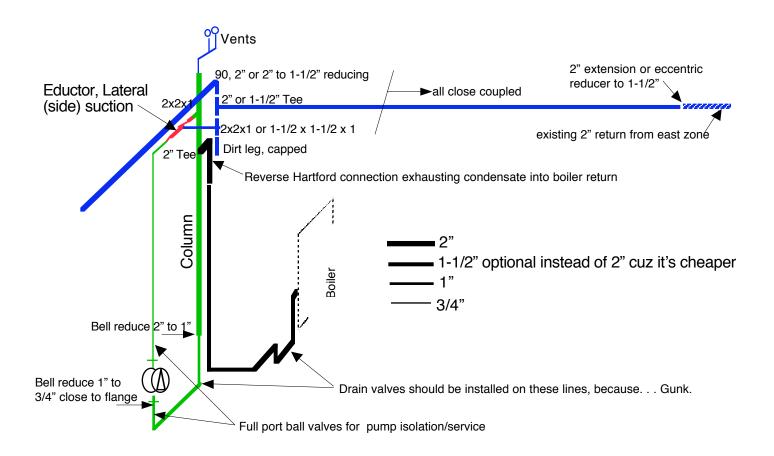

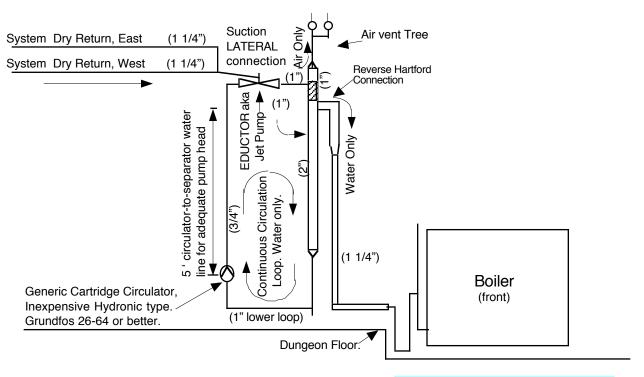

T.D.T. Efficient Steam @2013, 2014