


VI. Water Piping and Trim (continued)

- A. No further apart than four pipe diameters (or 12 inches), whichever is smaller.
 B. Keep this distance as short as practical.
 C. At least 18" of straight pipe for Conventional Air Scoop.

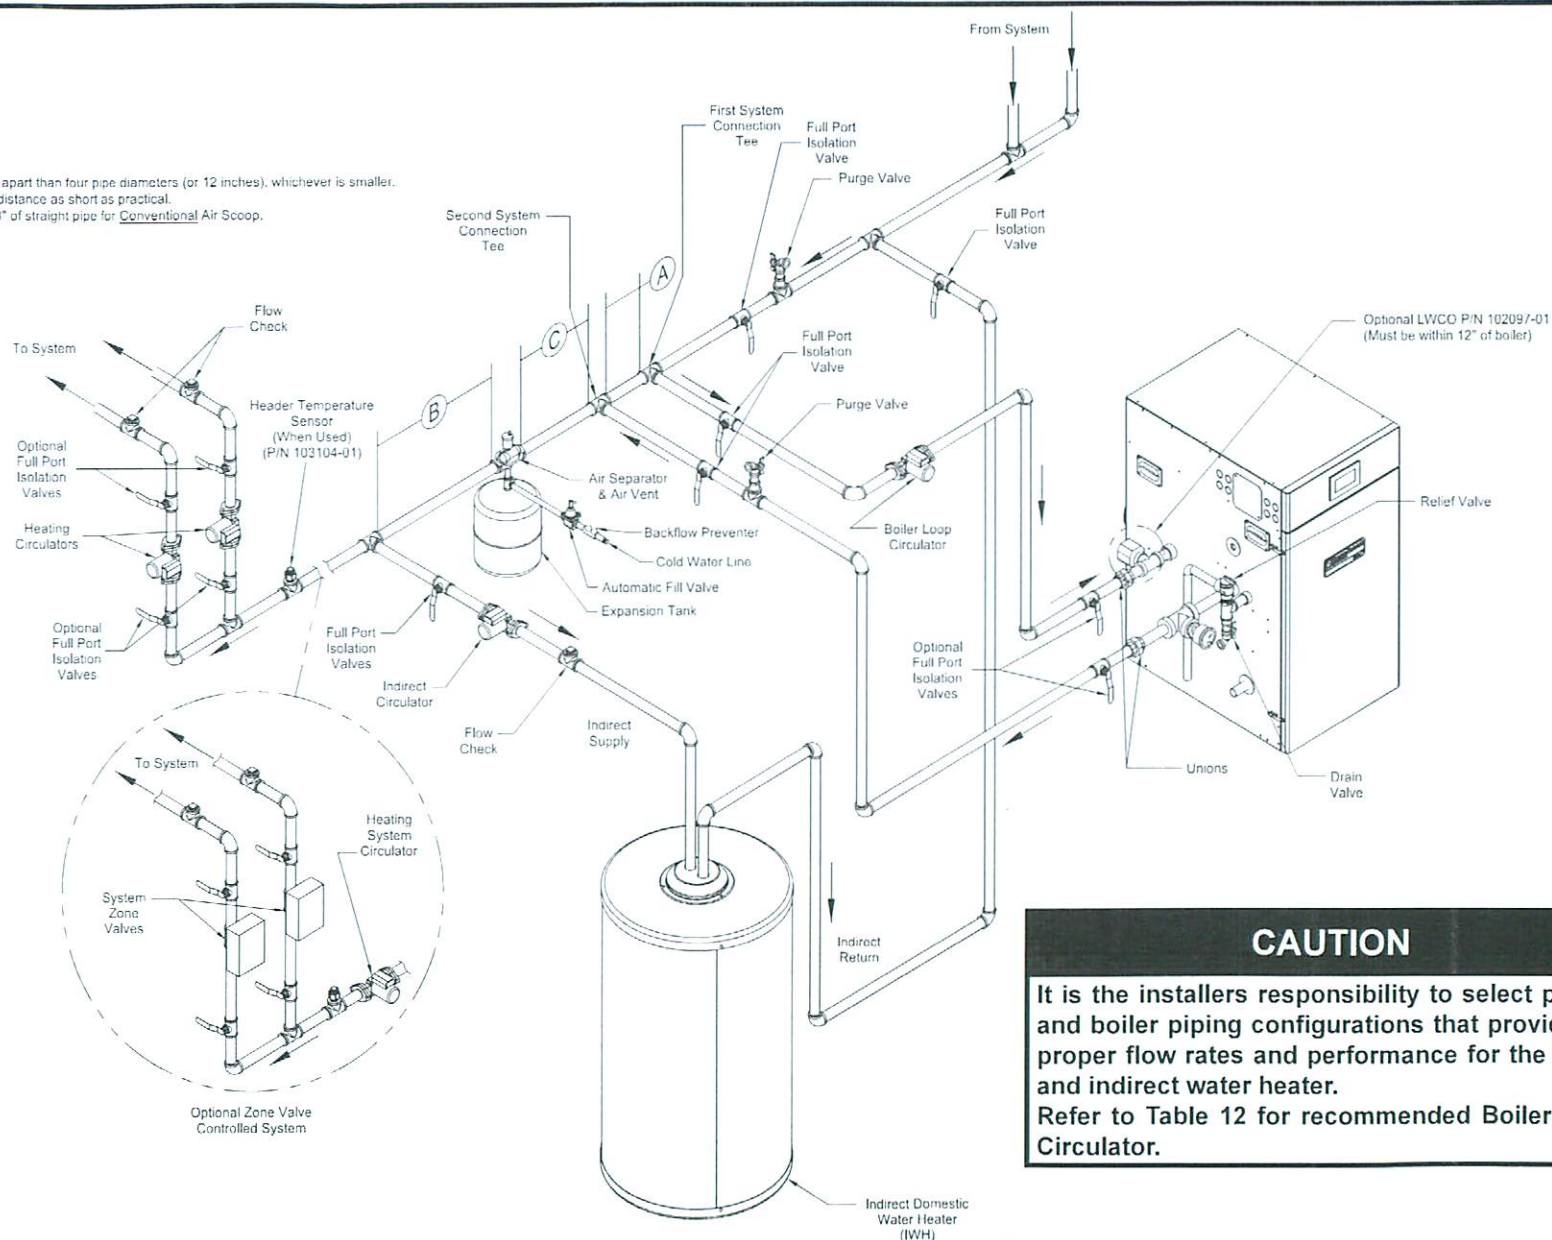

CAUTION

It is the installers responsibility to select pumps and boiler piping configurations that provide the proper flow rates and performance for the boiler and indirect water heater. Refer to Table 12 for recommended Boiler Loop Circulator.

Figure 32: Near Boiler Piping - Heating Plus Indirect Water Heater