



Existing CI Boiler System (some aux components (valves, etc.) not shown)

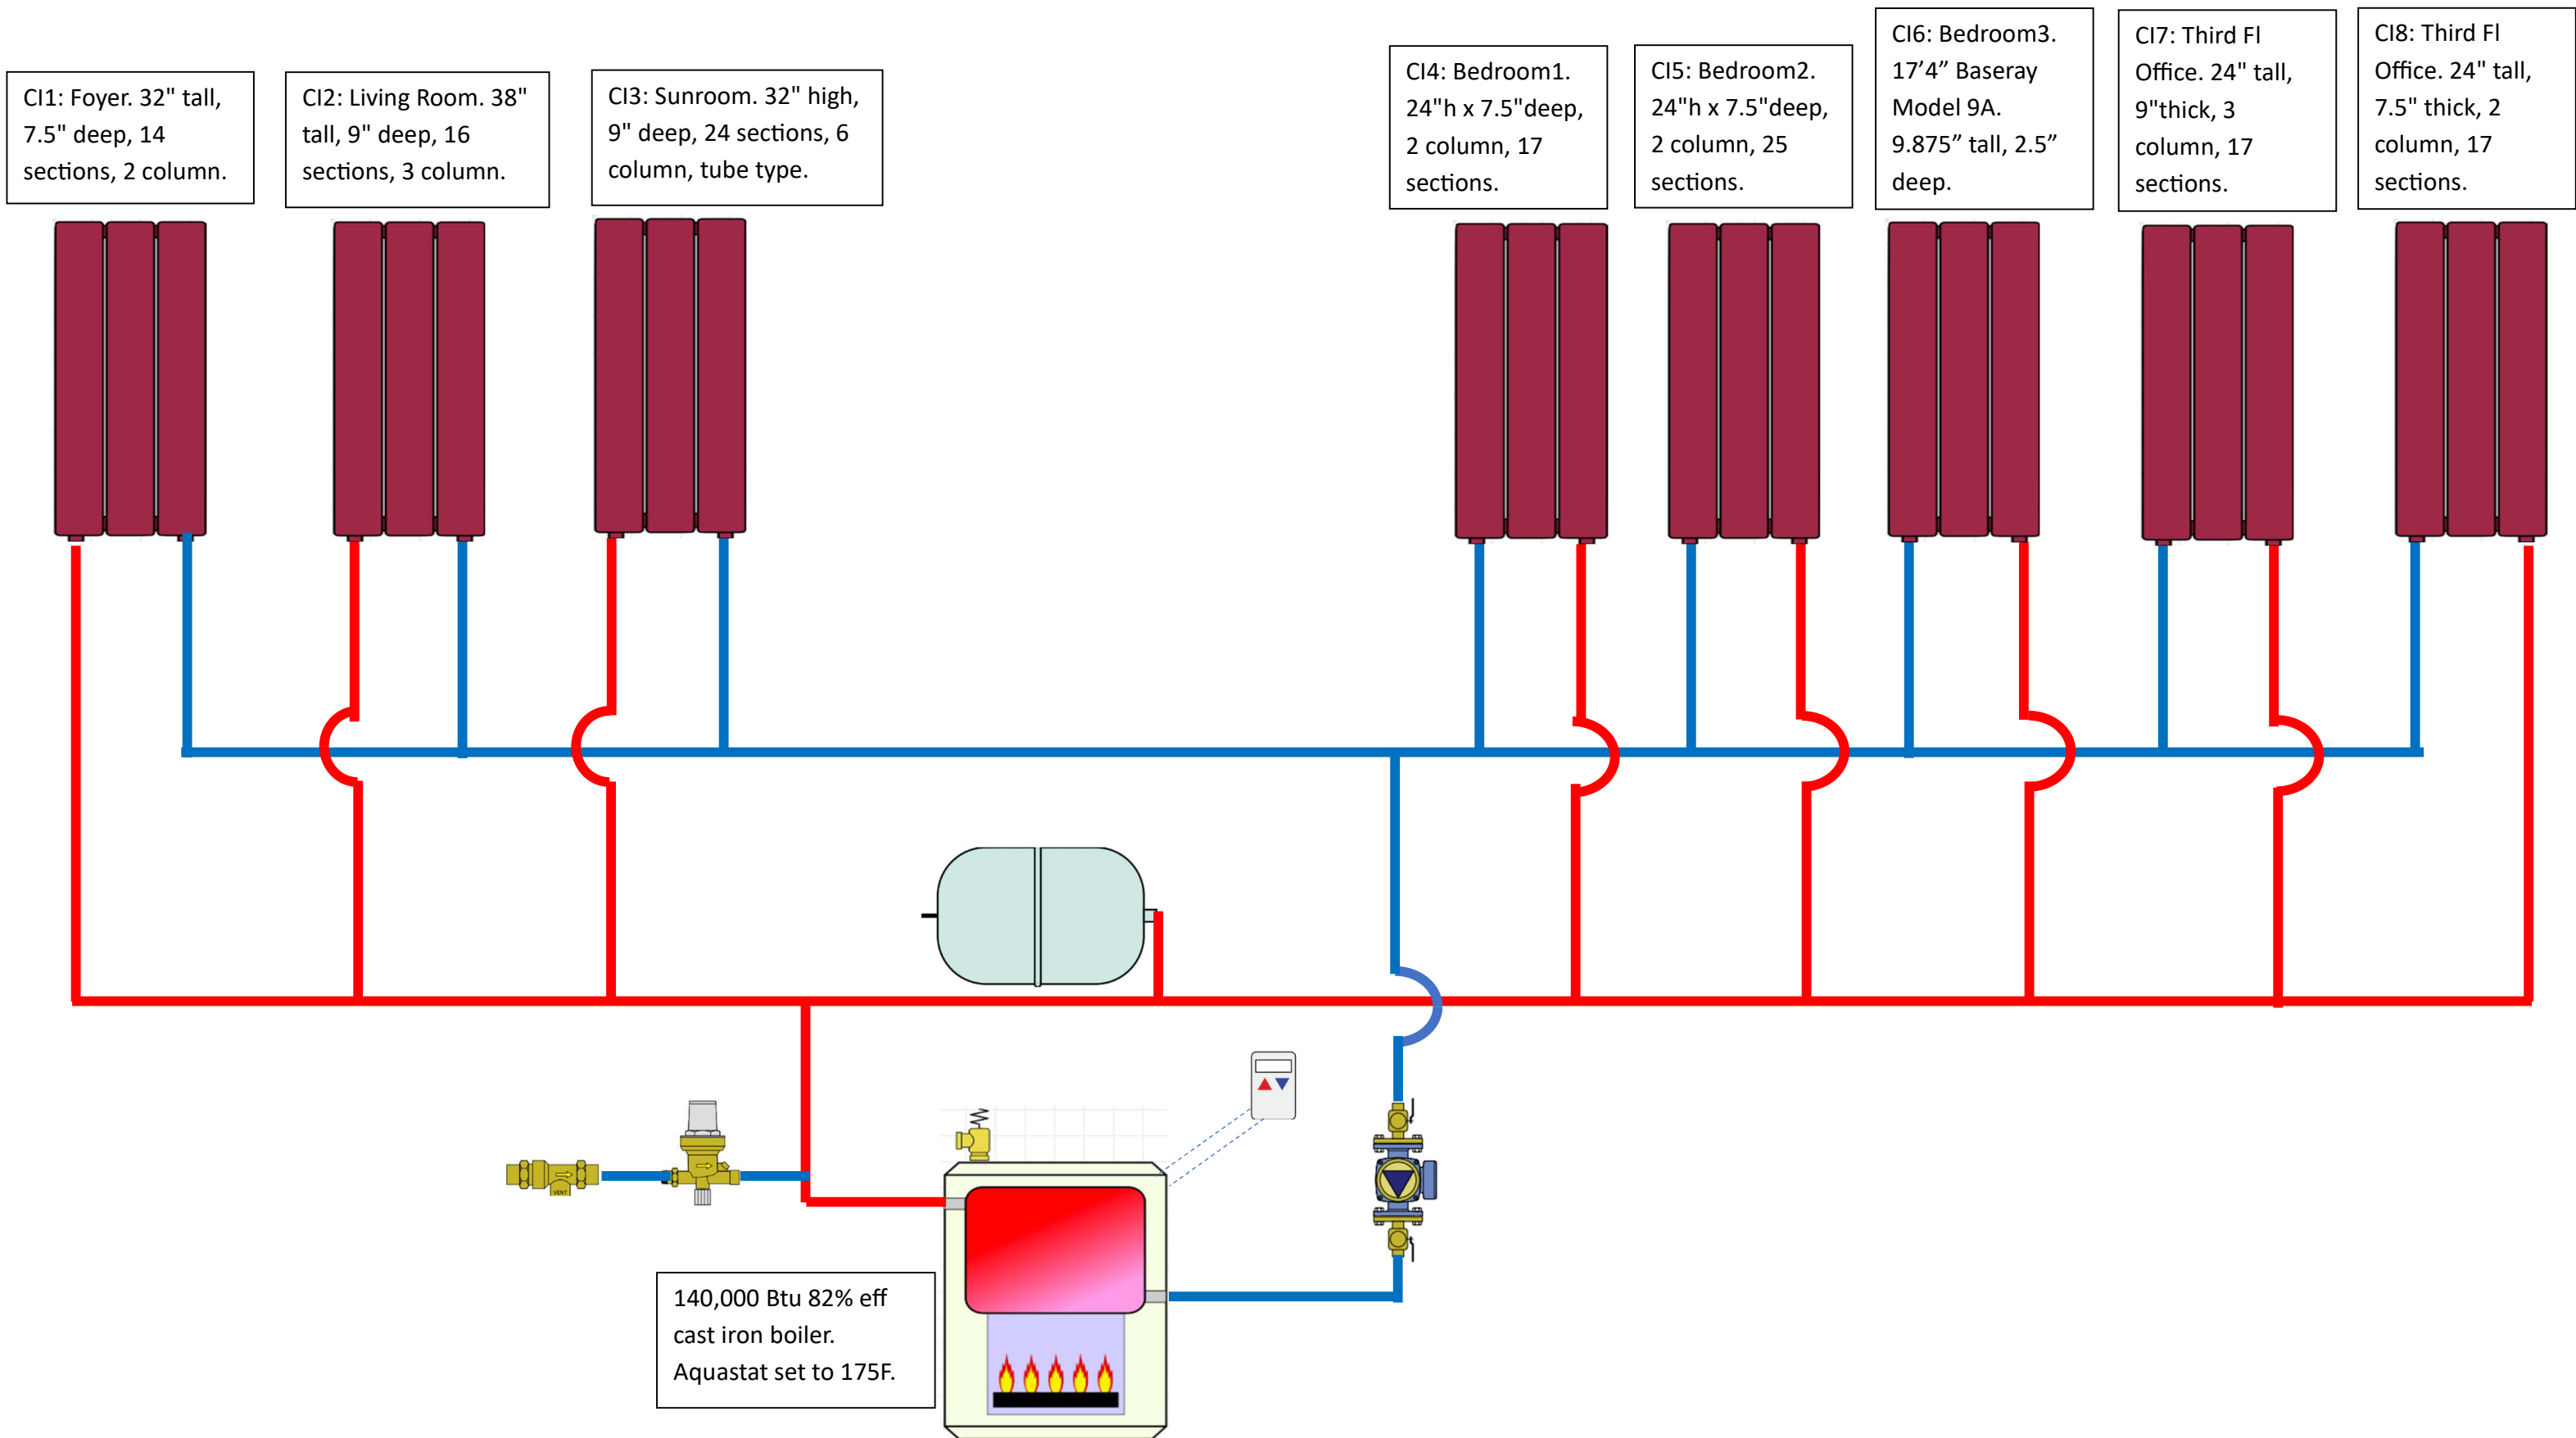

Existing Radiant Floor System (some aux components (valves, etc.) not shown)

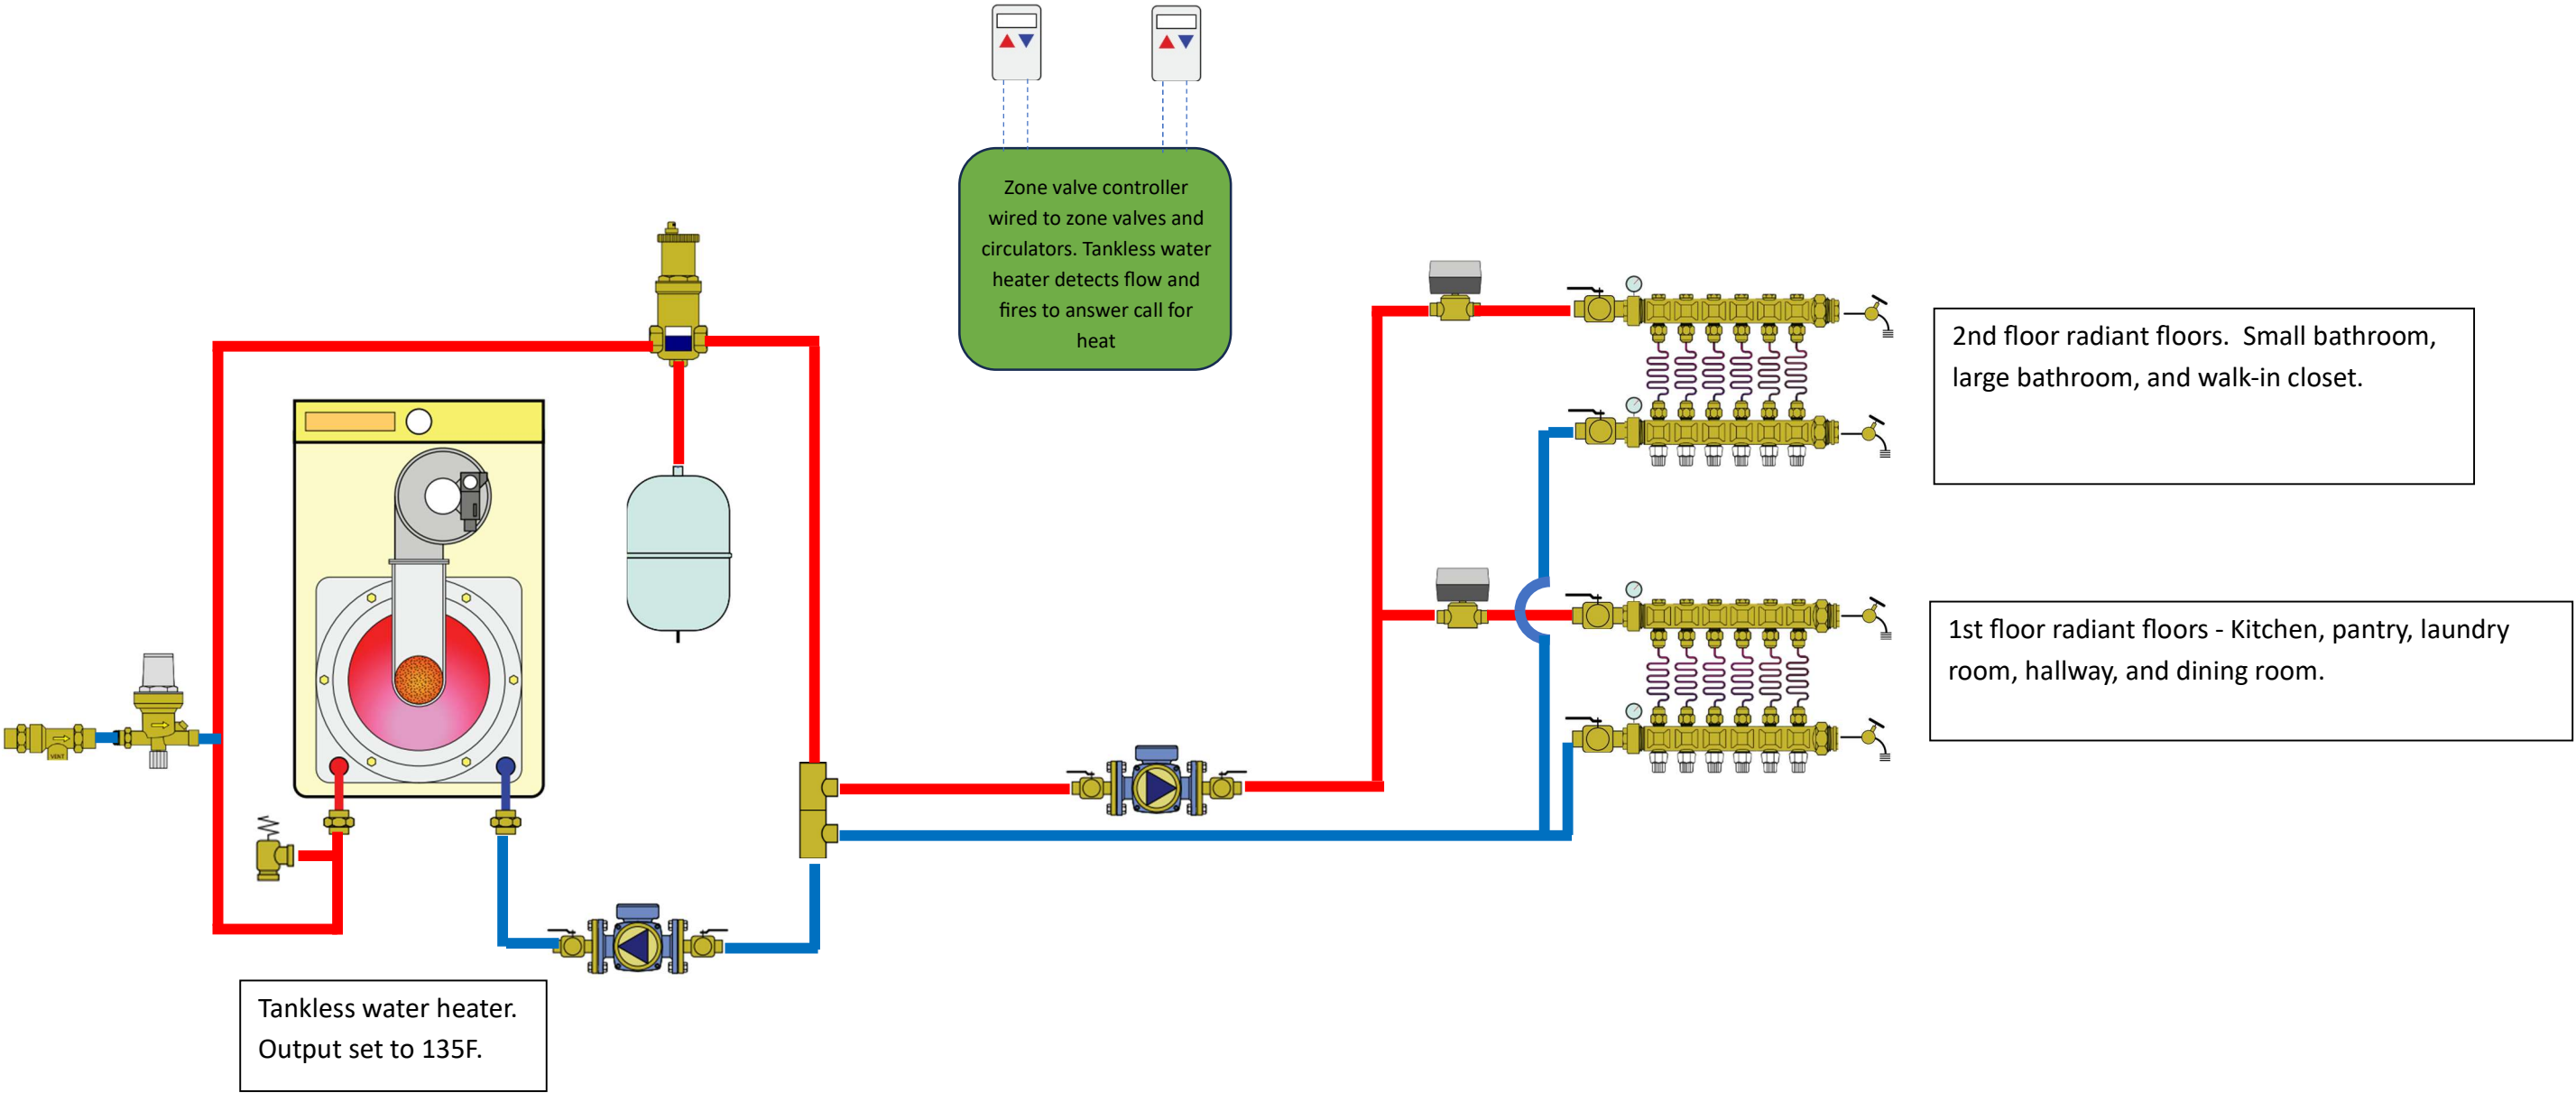

Desired Outcome – One Boiler Serving High and Low Temp Zones

