


Redesign of unit electro mechanical operation.

This modification permits the flow of waters to begin when MODUTROL motor begins to open due to slow closing of valve. There is no valve or check slam.

Honeywell MODUTROL motor, linkage & valve assembly

Mechanical Alternator

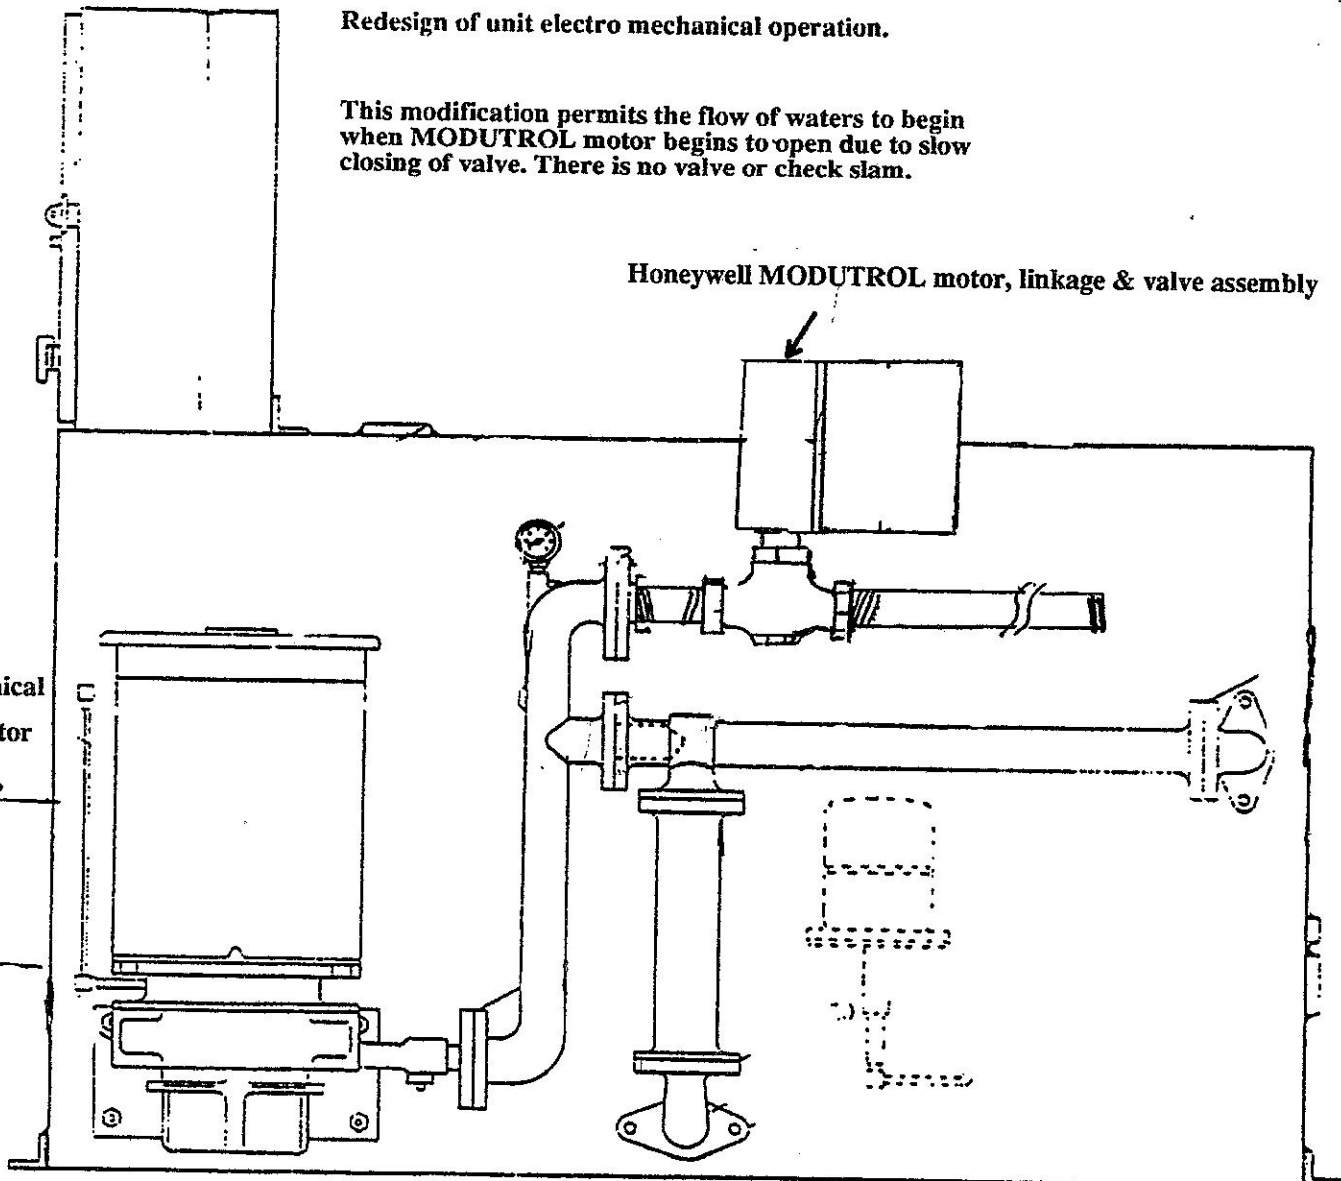

MODIFIED UNIT

PLATE #2